

ZHANGJIAGANG WELLYOUNG MATERIAL CO.,LTD

TEST REPORT

SCOPE OF WORK

FIREPROOF BOARD

REPORT NUMBER

240125004SHF-004

TEST DATE(S)

2024-01-25 - 2024-03-04

ORIGINAL ISSUE DATE

2024-03-07

PAGES


7

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10I(February 1, 2024)

© 2024 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

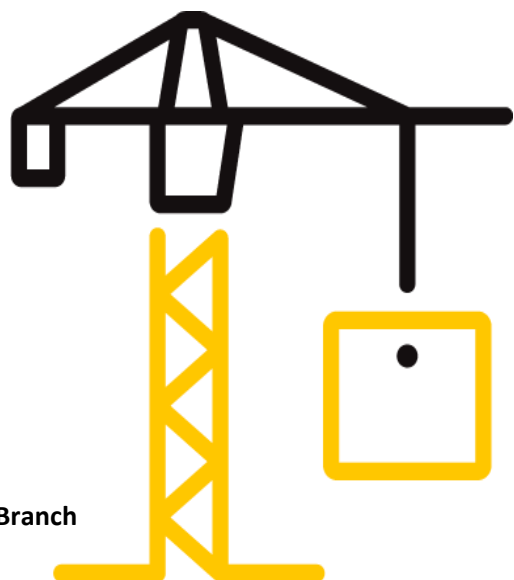

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.



Test Report

Original Issue Date: 2024-03-07

Intertek Report No. 240125004SHF-004

Applicant: ZHANGJIAGANG WELLYOUNG MATERIAL CO.,LTD

Address: ROOM1501-1504,BLOCKA,TIXIANG PLAZA,NO.88,HUACHANG ROAD,YANGSHE TOWN,ZHANGJIAGANG CITY,JIANGSU PROVINCE

Attn: Mr Liu

Manufacturer: ZHANGJIAGANG WELLYOUNG MATERIAL CO.,LTD

Address: ROOM1501-1504,BLOCKA,TIXIANG PLAZA,NO.88,HUACHANG ROAD,YANGSHE TOWN,ZHANGJIAGANG CITY,JIANGSU PROVINCE

Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	Model	Specification
FIREPROOF BOARD	/	1220mm*2440mm*12mm
Sample ID	Sample Amount	Sample Received Date
S240125004SHF.010~011	1 package	2024-01-23
Sample Description		
1220mm*2440mm*12mm		

Test Methods And Standards

Test Standard	EN 12467:2012+A2:2018 5.6.1, EN ISO 1182:2020, EN ISO 1716:2010
Specification Standard	EN 12467:2012+A2:2018, EN 13501-1:2018
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the testing applicant. Representativeness and authenticity of the submitted samples are responsibilities of the testing applicant.

Report Authorized

Sally
Name: Sally Xie
Title: Reviewer



Jackie Zhou
Name: Jackie Zhou
Title: Project Engineer

Test Report

Original Issue Date: 2024-03-07

Intertek Report No. 240125004SHF-004

Test Items, Method and Results:

EN 12467:2012+A2:2018			
Fibre-cement flat sheets - Product specification and test methods			
Clause	Requirement - Test	Result - Remark	Verdict
5.6	Fire and safety		
5.6.1	Reaction to fire When subject to the regulatory requirements, the reaction to fire of the sheets shall be declared in accordance with 7.5.	Class A1 (see page 5 to 6)	P



Test Report

Original Issue Date: 2024-03-07

Intertek Report No. 240125004SHF-004

Test Items, Method and Results:

EN 13501-1:2018 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests

1.1 NON-COMBUSTIBILITY TEST

The test was conducted in accordance with EN ISO 1182. This test evaluates the non-combustibility performance of products in a vertical tube at 750±5°C.

1.2 HEAT OF COMBUSTION TEST

The test was conducted in accordance with EN ISO 1716. This test evaluates the gross heat of combustion (Q_{PCS}) of products at constant volume in a bomb calorimeter.

1.3 CLASSIFICATION CRITERIA

The classification was determined in accordance with EN 13501-1:2018. The class A1 with its corresponding fire performance are given in the table below.

Table - Classes of reaction to fire performance for construction products excluding floorings and linear pipe thermal insulation products.

Class	Test Method(s)	Classification criteria	Additional classifications
A1	EN ISO 1182 ^a and	$\Delta T \leq 30^{\circ}\text{C}$; and $\Delta m \leq 50\%$; and $t_f = 0 \text{ s}$ (i.e. no sustained flaming)	--
	EN ISO 1716	$PCS \leq 2.0 \text{ MJ/kg}$ ^a and $PCS \leq 2.0 \text{ MJ/kg}$ ^b and $PCS \leq 1.4 \text{ MJ/m}^2$ ^c and $PCS \leq 2.0 \text{ MJ/kg}$ ^d	--

Note:

- a. For homogeneous products and substantial components of non-homogeneous products.
- b. For any external non-substantial component of non-homogeneous products.
- c. For any internal non-substantial component of non-homogeneous products.
- d. For the product as a whole.



Test Report

Original Issue Date: 2024-03-07

Intertek Report No. 240125004SHF-004

Test Items, Method and Results:

2 RESULTS AND OBSERATIONS

Method	Parameter		Result
EN ISO 1182:2020	ΔT (°C)		2.4
	Δm (%)		38.5
	t_f (s)		0
EN ISO 1716:2010	PCS	The whole product, MJ/kg	-0.1253

3 CLASSIFICATION

The classification has been carried out in accordance with EN 13501-1.

Fire behaviour		Smoke production		Flaming Droplets
A1	-	s	Not applicable	- d Not applicable

Reaction to fire classification: A1



Test Report

Original Issue Date: 2024-03-07

Intertek Report No. 240125004SHF-004

Appendix A: Sample Received Photo



Revision:

NO.	Date	Changes
240125004SHF-004	2024-03-07	First issue

